


Troubleshooting the AcornVac system

This chart is a quick reference guide and not intended as a substitute for the full O&M Manual which contains further trouble shooting information.

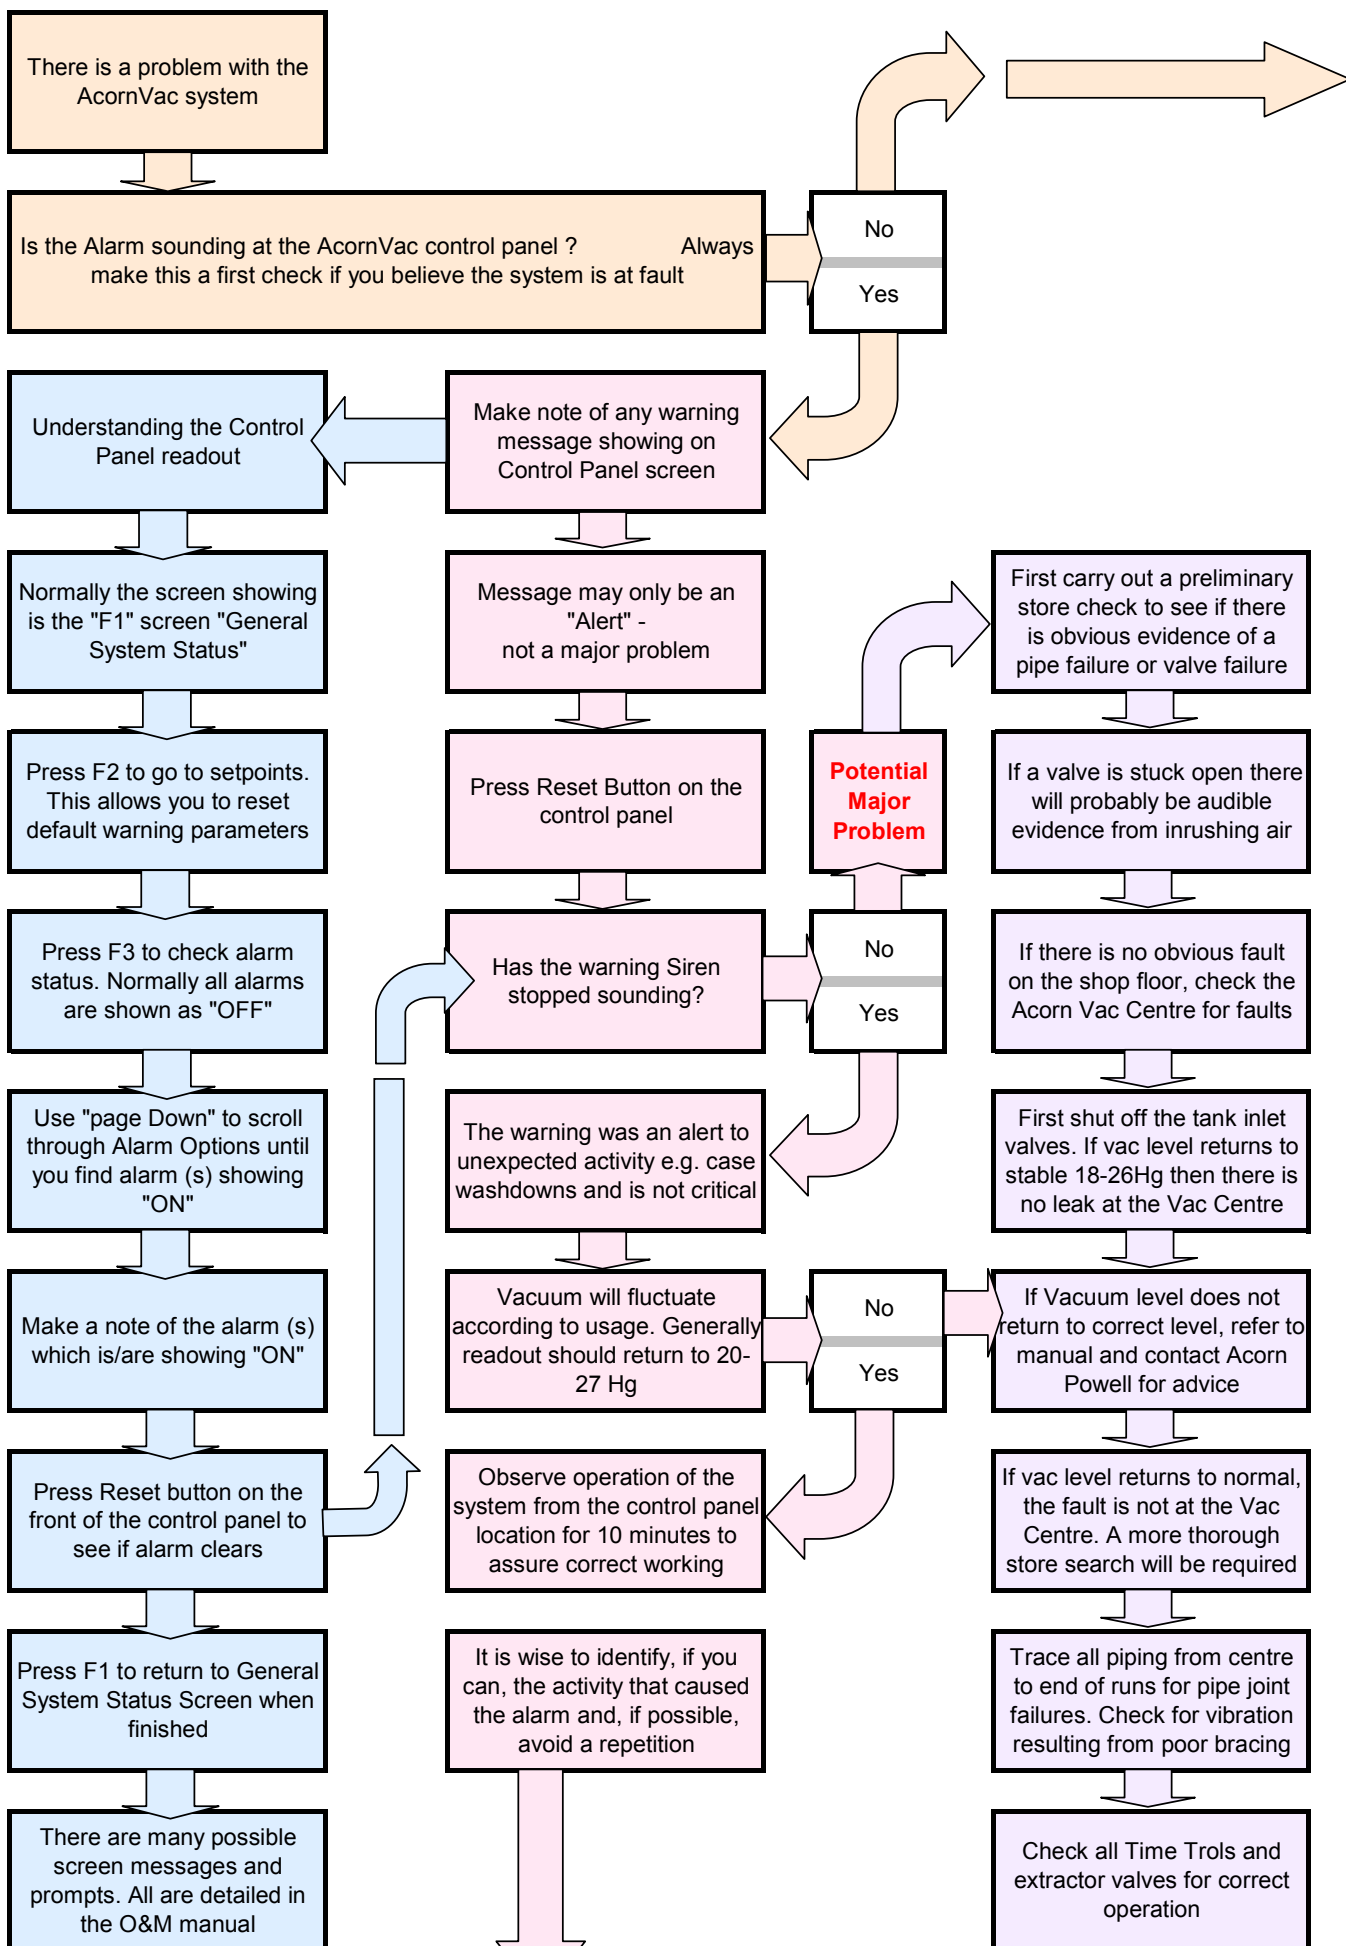

If no cure is identifiable call Acorn Powell for advice or call direct to AcornVac support in the USA

System OK

Need help?

- 1) check for obvious faults / identify general nature of problem
- 2) Call your store service / maintenance agent / engineer
- 3) If further assistance is required call Acorn Powell 01452 721211
- 4) If technical / emergency assistance is required and Acorn Powell is closed, call AcornVac direct: 001 800 591 9920

Remove tube from sensor port on the Time Trol and blow through to dislodge blockage

3 Possibilities:
1) There is debris or water blocking the sensor tube

If not easily accessible try flexible rodding from above through air intake, or hand hot water flush - **not boiling!**

2) The accumulator itself is blocked with debris, waste etc.

WARNING never flush water over 60c into vacuum! (Water boils at 60C in a vacuum)

causing failure of signal reaching the Time Trol. Consult with Acorn Powell

3) there is a vacuum leak in the sensor port pipe / cap / tube assembly

Checking this may require some time - be patient! Is the Time Trol now activating automatically and the accumulator emptying.

